


# ALL IN ONE Under Sink System

## INSTALLATION INSTRUCTIONS

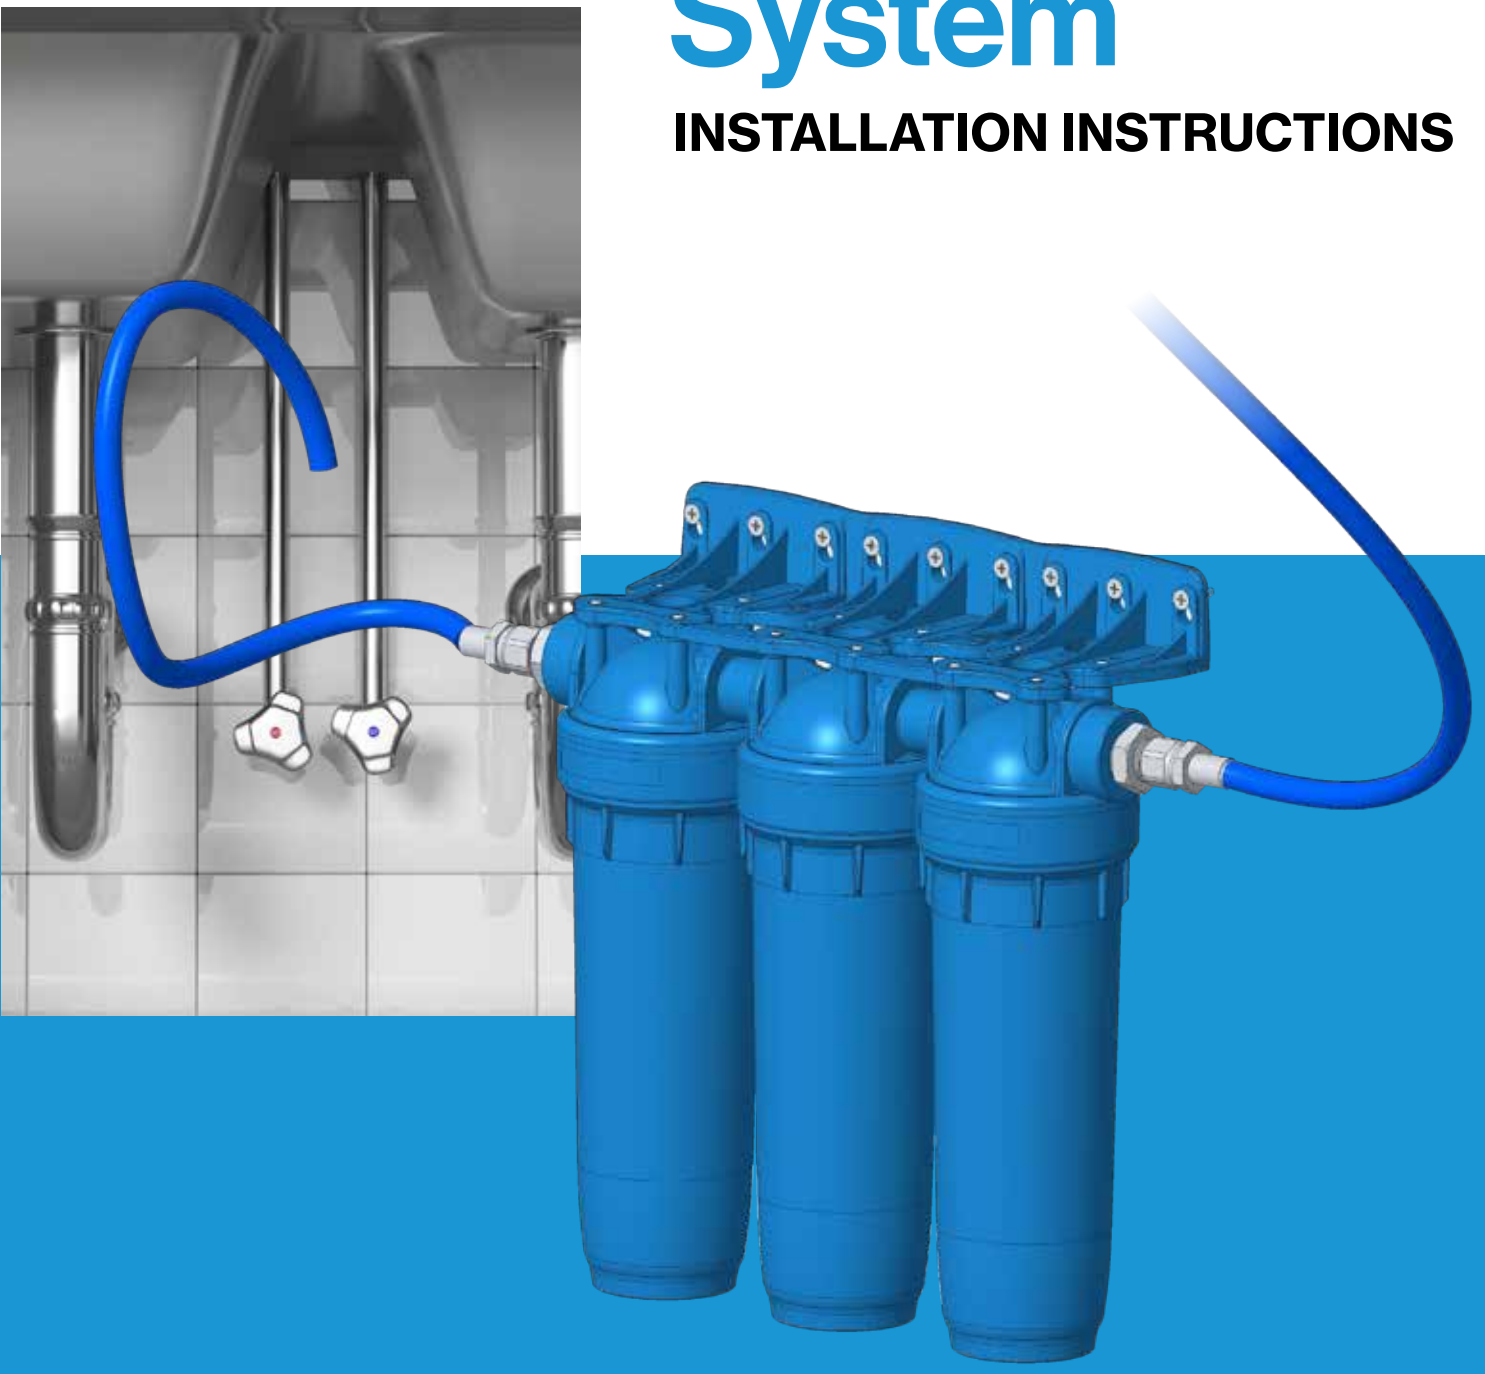

### Premium Under Sink Filtration System

Campbell Ultrafiltration is installed on the water line under the sink, as the system is to be supplied with cold water. For best performance, the filtration system should not be exposed to temperatures below 39° F or above 113° F. The system and installation shall comply with applicable state and local regulations.














# PREMIUM WHOLE HOUSE FILTRATION SYSTEM

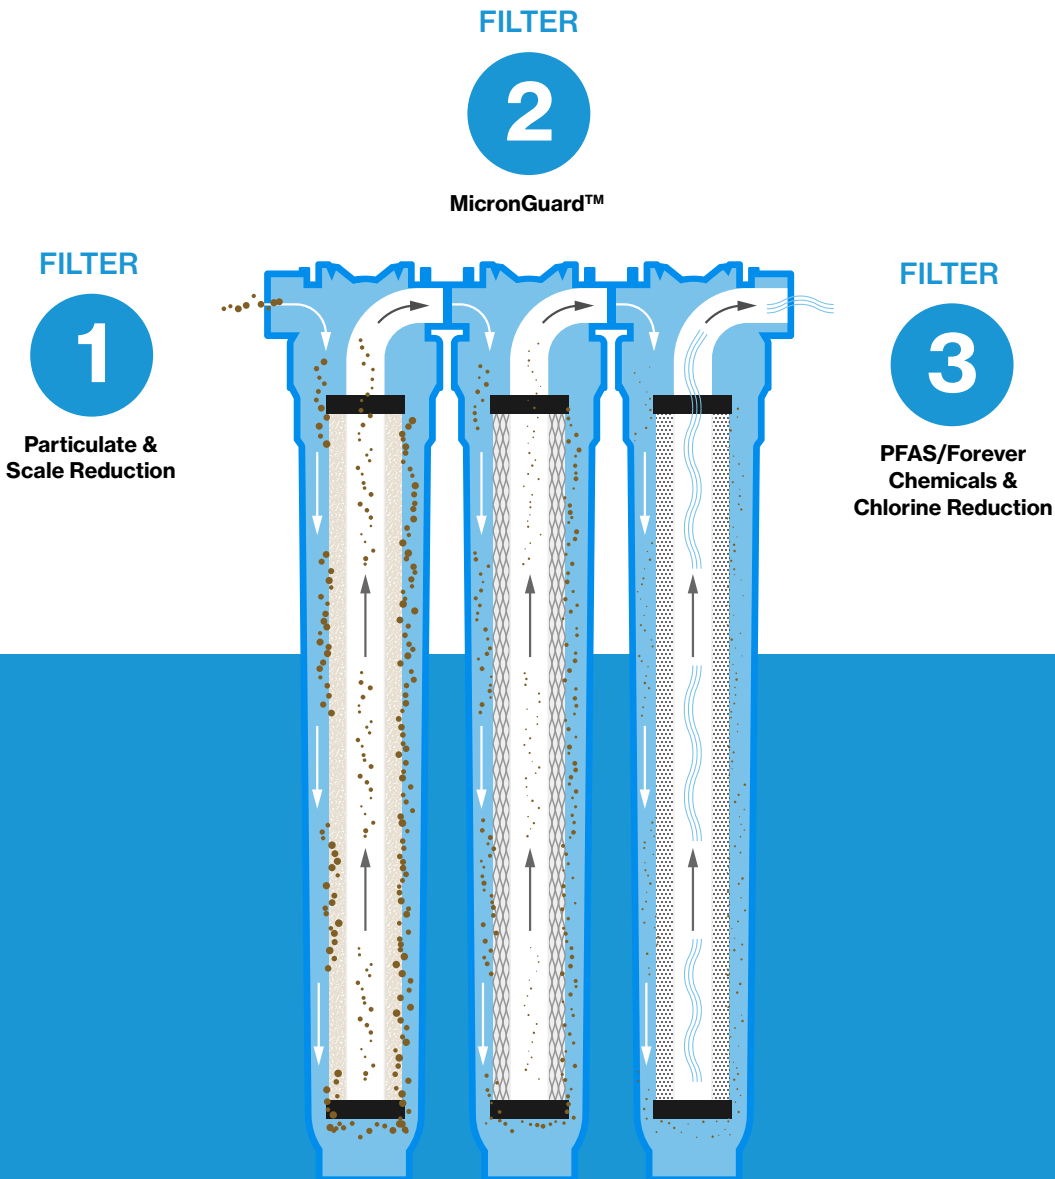

Replacement Filter Information	
Under Sink Unit Model	#CT101-02SINK
Filter #1 Replacement P/N	#2510Camp
Filter #2 Replacement P/N	#2510Blo
Filter #3 Replacement P/N	#2510CC



Manufactured By:  
Campbell Manufacturing LLC  
127 E. Spring St  
Bechtelsville, PA 19505  
[BakerWaterSystems.com](http://BakerWaterSystems.com)

The system complies with NSF/ANSI 42 and 53 standards for the specific performance claims that have been verified and substantiated by nationally recognized third-party laboratories at the 4 GPM flow rate. Calculations for system capacity at 2.2 GPM flow rate utilize data from EPA.gov and The Water Research Foundation. System also complies with NSF/ANSI 61 and 372 lead free. Do not use with water that is microbiologically unsafe or of unknown quality without adequate disinfection before or after the system.

Manufacturers Warranty Information: [CampbellUltrafiltration.com/warranty](http://CampbellUltrafiltration.com/warranty)

©2023 Baker Water Systems. All rights reserved.



[WWW.GREENER-SAFER.COM](http://WWW.GREENER-SAFER.COM) / (253) 234-4810