

ALL IN ONE Under Sink System

INSTALLATION INSTRUCTIONS



Premium Under Sink Filtration System

Campbell Ultrafiltration is installed on the water line under the sink, as the system is to be supplied with cold water. For best performance, the filtration system should not be exposed to temperatures below 39° F or above 113° F. The system and installation shall comply with applicable state and local regulations.

ALL IN ONE Whole House System

IMPORTANT

The Campbell Ultrafiltration Under Sink System should be installed by a licensed and bonded professional.


In order to maintain the highest quality filtered water throughout the home, please refer to the PDS (Performance Data Sheet) for rated service flow, rated capacity, maximum working pressure, and filter replacement frequency.

The system complies with NSF/ANSI 42 and 53 standards for the specific performance claims that have been verified and substantiated by nationally recognized third-party laboratories at the 4 GPM flow rate. Calculations for system capacity at 2.2 GPM flow rate utilize data from EPA.gov and The Water Research Foundation. System also complies with NSF/ANSI 61 and 372 lead free. Do not use with water that is microbiologically unsafe or of unknown quality without adequate disinfection before or after the system.

The chamber labels provide information for re-ordering filters.




ULTRAFILTRATION SYSTEM

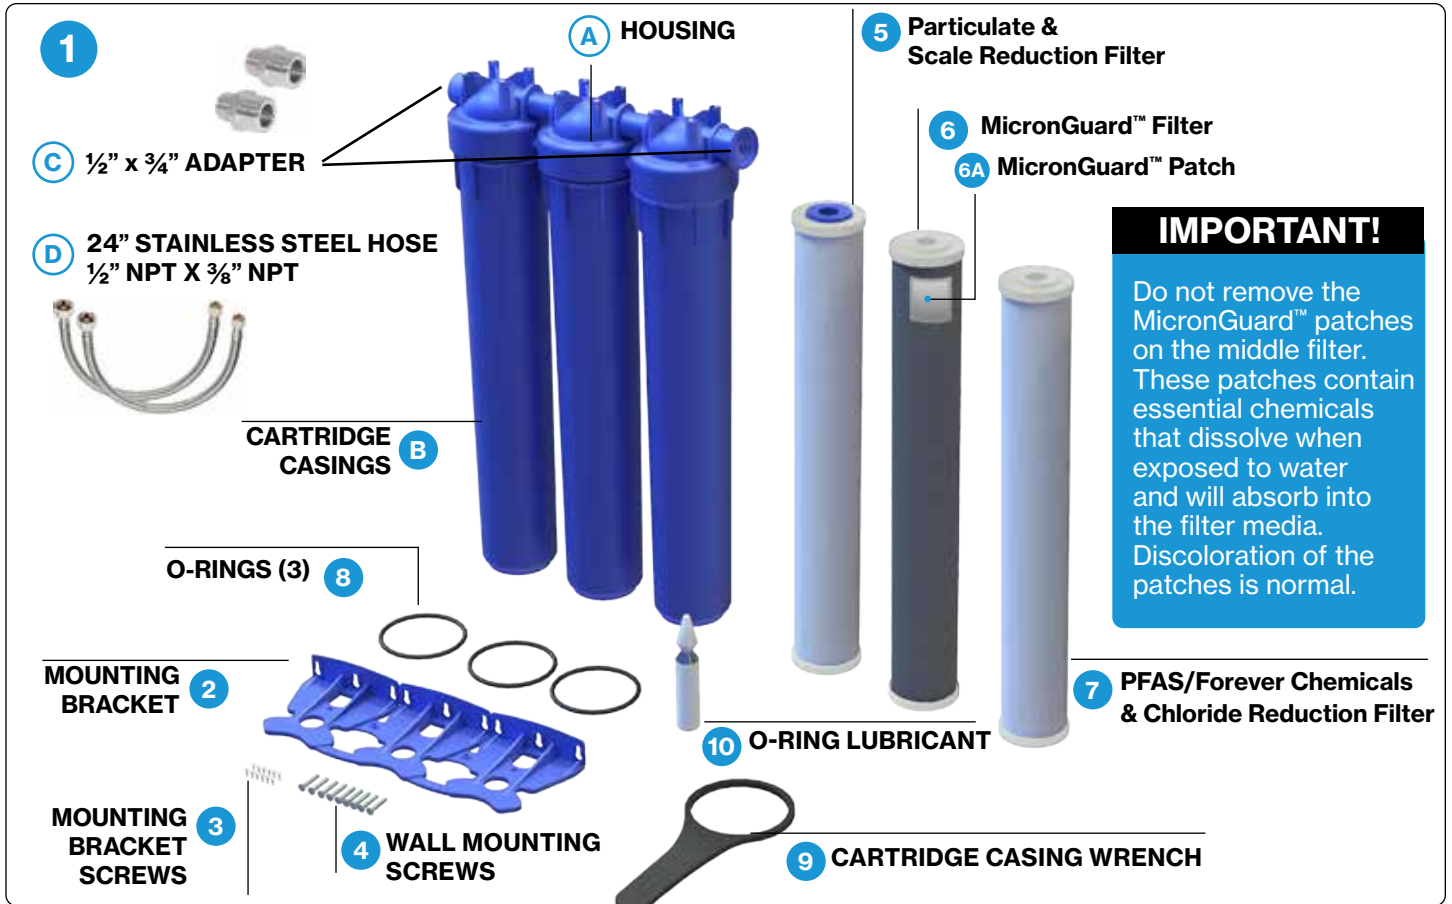


IMPORTANT!

Do not remove the MicronGuard™ patches on the middle filter. These patches contain essential chemicals that dissolve when exposed to water and will absorb into the filter media. Discoloration of the patches is normal.

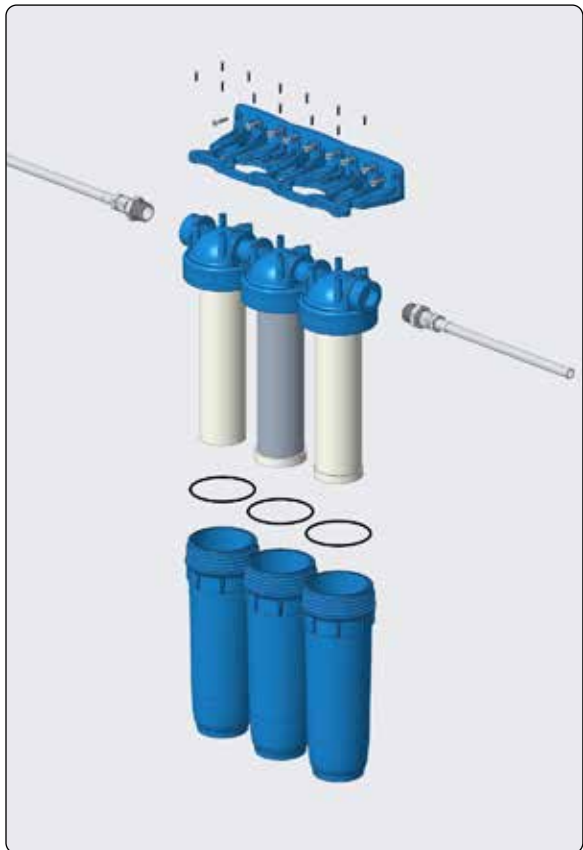

SYSTEM COMPONENTS:

- 1 ULTRAFILTRATION  UNDER SINK SYSTEM CONSISTS OF A HOUSING (A) CARTRIDGE CASINGS (B) AND ADAPTERS (C)
- 2 MOUNTING BRACKET
- 3 MOUNTING BRACKET SCREWS (12)
- 4 WALL MOUNTING SCREWS (9)
- 5 PARTICULATE FILTER & SCALE REDUCTION
- 6 MICRONGUARD™ FILTER (6A) MicronGuard™ Patches. **DO NOT REMOVE!**
- 7 PFAS/FOREVER CHEMICALS & CHLORIDE REDUCTION FILTER
- 8 O-RINGS (3)
- 9 CARTRIDGE CASING WRENCH
- 10 O-RING LUBRICANT



Mounting the System at the Water Main

1

Identify the incoming water line and shut off the water supply at the shut off valve if equipped or at the main line to the home.


2



Use the included hoses to install the unit.

3

Mount the bracket to the housing (optional).

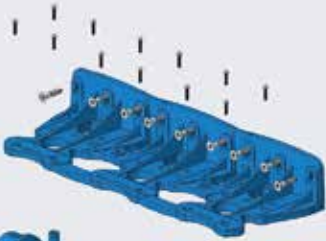


4

Mount the assembled unit to the wall (optional).



5

If mounting the unit to the wall or cabinet under the sink, ensure there is adequate room beneath the unit to remove cartridge casing to change filters. Approximately three inches is recommended.

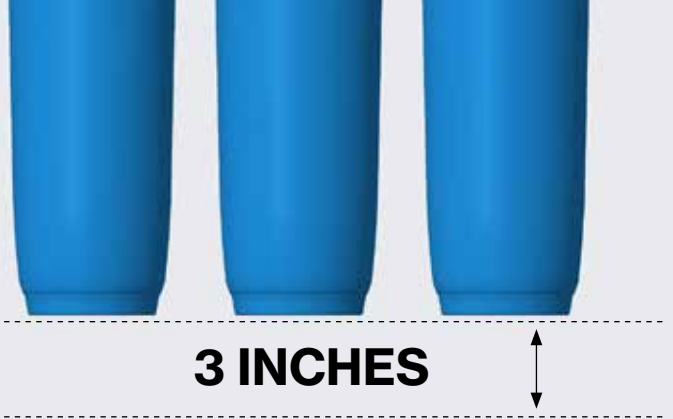

3 INCHES

6

Attach one end of the included hose to the cold water supply connection. Attach the other end of that hose to the inlet on the unit nearest filter 1.



Attach the second hose to the outlet on the unit nearest filter 3. The other end of the hose then attaches to either the existing 1/2" faucet pipe connection or existing cold water supply line via optional compression adapter fitting.

Installing the O-Rings and the Filters


- 7** Remove the cartridge casings with the supplied wrench (counter clockwise).



- 8** Lubricate the 3 O-Rings and install each into the groove in the cartridge casings.



- 9** Install the 3 filters in the proper order:
- 1 Particulate Filter & Scale Reduction
 - 2 MicronGuard™ Filter
 - 3 PFAS and Scale Reduction Filter

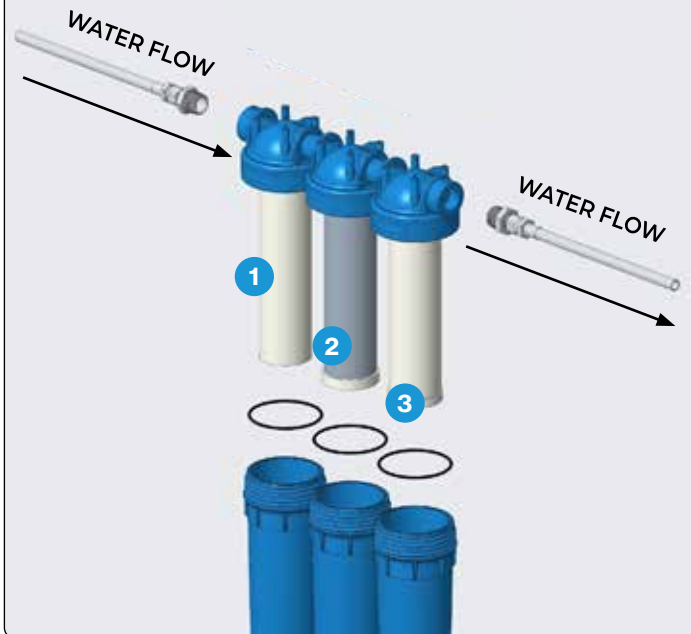

- 10** Tighten all 3 of the cartridge casing units with the supplied wrench (clockwise).



Opening the Water Valves

- 11** Turn on the water at the cold water supply connection.



- 12** Check connections for leaks.




ONE LAST STEP!

Turn on the water at the shut-off valve under the sink (or master valve). Turn on the faucet and let the water run for five minutes.



Congratulations!
You now have cleaner, safer water
right from the tap.

PREMIUM WHOLE HOUSE FILTRATION SYSTEM

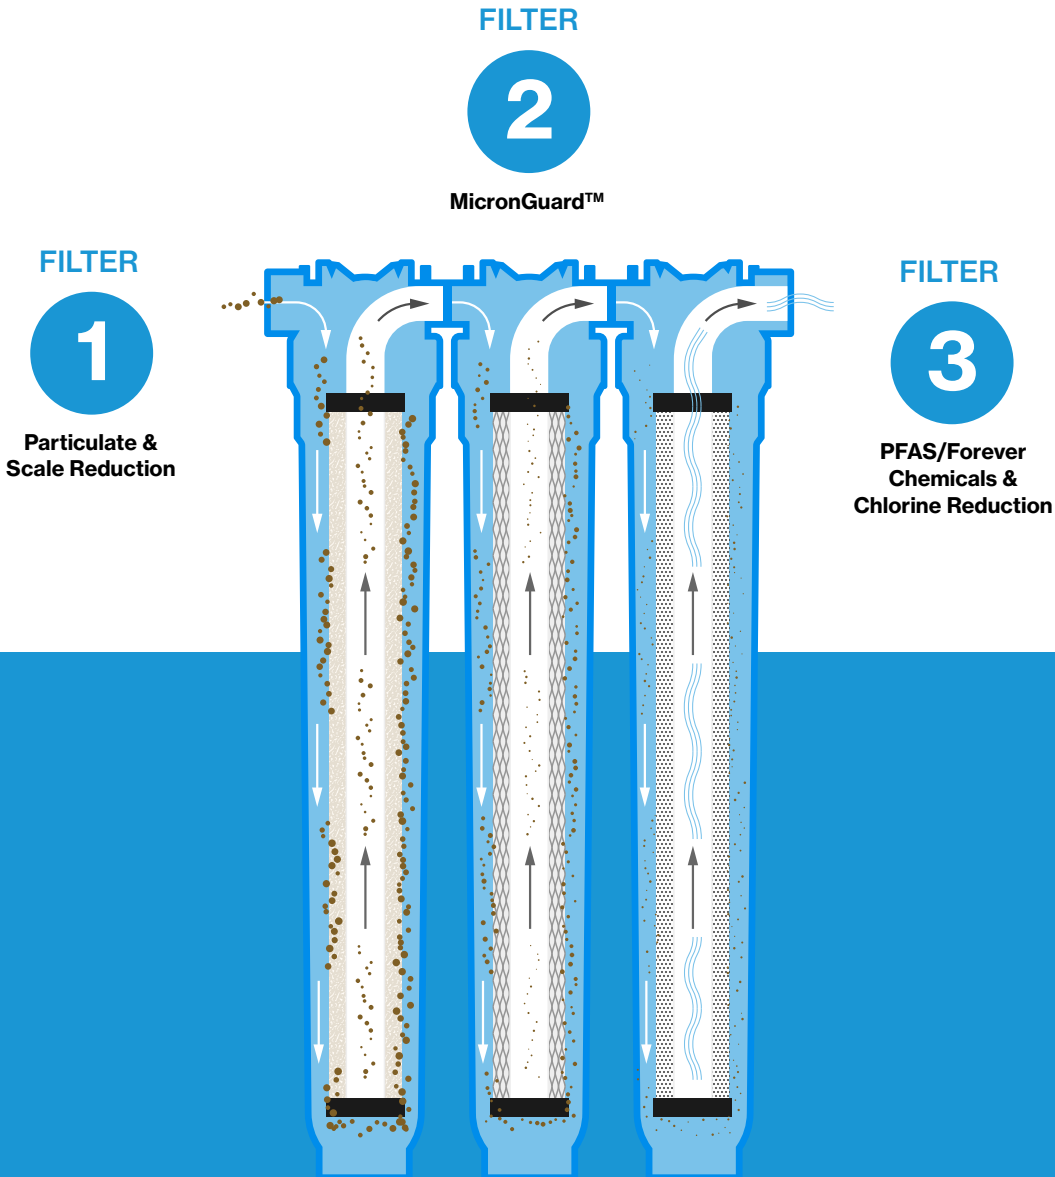

Replacement Filter Information	
Under Sink Unit Model	#CT101-02SINK
Filter #1 Replacement P/N	#2510Camp
Filter #2 Replacement P/N	#2510Blo
Filter #3 Replacement P/N	#2510CC



Manufactured By:
Campbell Manufacturing LLC
127 E. Spring St
Bechtelsville, PA 19505
BakerWaterSystems.com

The system complies with NSF/ANSI 42 and 53 standards for the specific performance claims that have been verified and substantiated by nationally recognized third-party laboratories at the 4 GPM flow rate. Calculations for system capacity at 2.2 GPM flow rate utilize data from EPA.gov and The Water Research Foundation. System also complies with NSF/ANSI 61 and 372 lead free. Do not use with water that is microbiologically unsafe or of unknown quality without adequate disinfection before or after the system.

Manufacturers Warranty Information: CampbellUltrafiltration.com/warranty

©2023 Baker Water Systems. All rights reserved.



WWW.GREENER-SAFER.COM / (253) 234-4810